

GENERAL NOTES:


- A. ALL WORK SHALL CONFORM TO ALL LOCAL, STATE, AND THE 2018 IRC CODES.
- C. REINFORCING SHALL CONFORM TO ASTM A615, GRADE 60 AND LAP 30 BAR DIAM. REINFORCING SHALL BE CONTINUES AROUND ALL CORNERS.
- D. CONTRACTOR SHALL VERIFY ALL SITE CONDITIONS AND DIMENSIONS BEFORE STARTING WORK.
- E. WOOD WITHIN 6" OF GROUND AND SILLS TO CONCRETE OR BLOCK TO BE PRESSURE TREATED TO FOUNDATION GRADE STANDARD FOR USE IN GROUND CONTACT PER REQUIREMENTS OF AMERICAN WOOD PRESERVES BUREAU STANDARD A.W.P.B.- FDN FOR USE IN GROUND CONTACT.
- F. PROVIDE A 18' X 24' MINIMUM ACCESS HATCH AT ONE LOCATION MIN. AIR VENTS SHALL BE SPACED AROUND THE HOME AT 1 SQ. FR. OF VENT PER 150 SQ. FT. OR FLOOR AREA. OR PROVIDE CROSS-VENTILATION W/ CRAWL SPACES EQUAL TO MINIMUM VENTILATION REQUIREMENTS



ENGINEER:
 BBACA ENGINEERING, LLC
 ATTN: RALPH BACA, PE
 (480) 706-6222
 Ralph@bbacaengineering.com

OWNER:
 RICHARD IMUS
 PO BOX 279
 MOUNT VERNON, WA 98273

REVISIONS

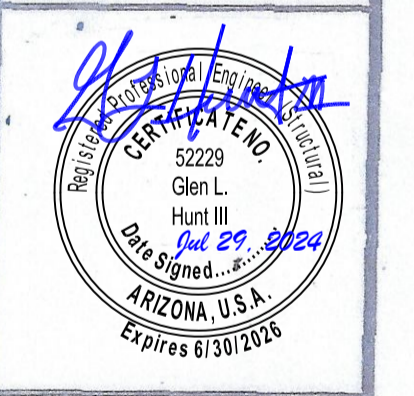

PROJECT:
 TYPICAL MANUFACTURED HOME SKIRTING PLAN - BELOW GRADE
 FACTORY MANUFACTURED HOUSING

DATE:
 SCALE: AS NOTED
 DRAWN BY:
 REVIEWED BY: R.B.
 PROJECT NUMBER:
 240126-1054E
 SHEET: